


PLAN

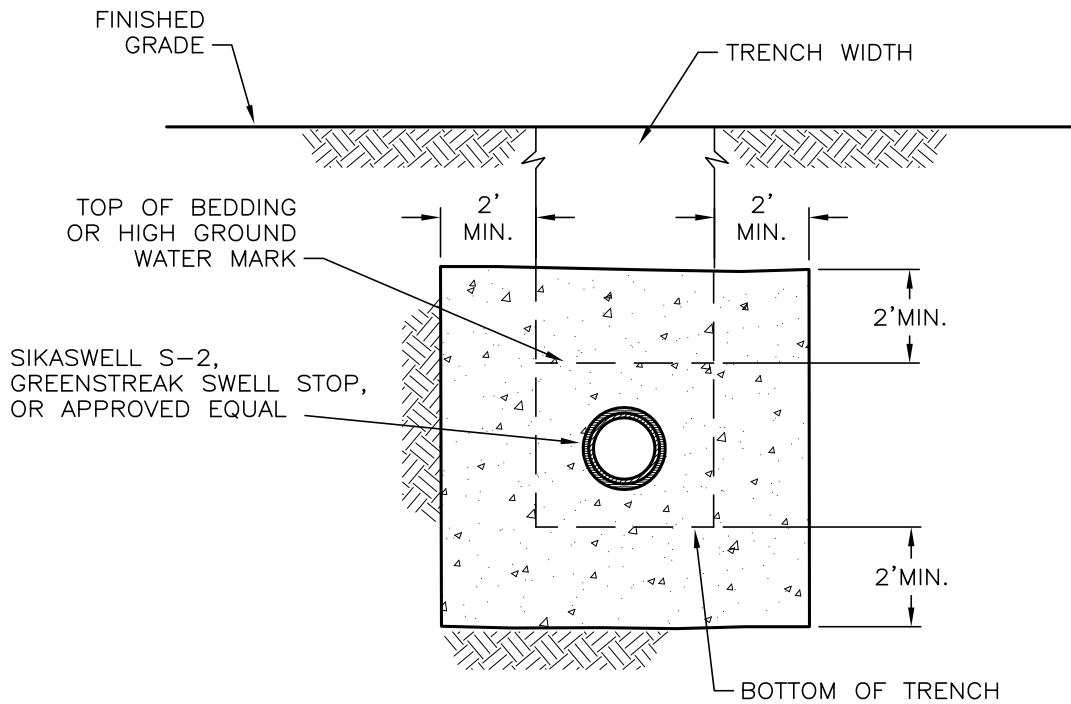

SECTION

NOTES:

1. WATER STOPS SHALL BE CONSTRUCTED AT 200-FOOT MAXIMUM SPACING IN GROUND WATER CONDITIONS AND WHERE WET TRENCH BEDDING IS USED, AS DIRECTED BY SEWER UTILITY.
2. WRAP PIPE WITH SIKASWELL S-2, OR, GREENSTREAK SWELL STOP, OR EQUIVALENT WHERE PIPE IS EXPOSED TO CONCRETE PRIOR TO POURING.
3. USE LIGHT CONCRETE TYPE A SLURRY BACKFILL PER ORANGE BOOK 337.08.01-1. IF CEMENT BOARD IS USED FOR CONCRETE FORMS, IT MAY BE LEFT IN PLACE.

NO.	REVISION	DATE	STANDARD DETAIL FOR PUBLIC WORKS CONSTRUCTION	SECTION: DOUGLAS COUNTY
			WATER STOP	DATE: JULY 2017
				DWG: D02